


DRIP VALVE: VALVE MAY BE OF ANY TYPE. IF DRIP VALVE HAS HOSE THREADS, A NON-REMOVABLE VACUUM BREAKER MUST BE INSTALLED

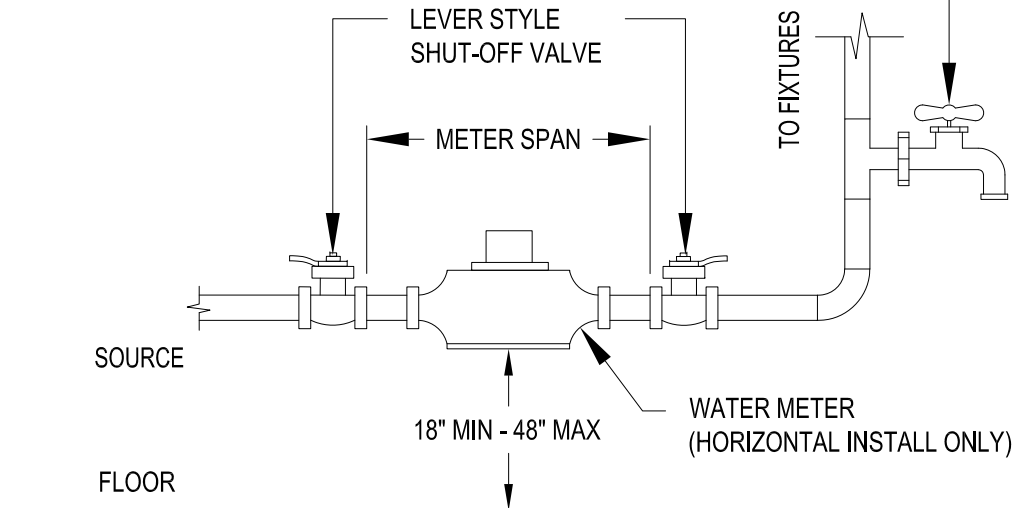

NOTES:

1. IF METER IS TO BE ENCLOSED, REMOVABLE PANELS SHALL BE USED SO THAT ACCESS TO THE METER AND VALVES IS PROVIDED.
2. ACCESS PANEL OPENING MUST BE LARGER THAN METER FOR REMOVAL, INSTALLATION OR SERVICE.
3. IF ENCLOSED, METER MUST BE 6" - 24" BACK FROM ENCLOSURE.
4. PROVIDE MINIMUM 12" OF CLEARANCE ABOVE METER.
5. METER SHALL BE INSTALLED INSIDE THE BUILDING IN AN ACCESSIBLE LOCATION.
6. METER SHALL NOT BE INSTALLED IN A CRAWL SPACE OR PIT.
7. METER TO MEET MANUFACTURERS SPECIFICATIONS FOR UPSTREAM PIPE REQUIREMENTS.

Revised:
1. 06/12/2015
2. 09/22/2015
3. 03/07/2016
4. 8/18/2023 JRG- LEVER STYLE VALVE

Drawing Name
<b>TYPICAL WATER METER INSTALLATION</b>

Drawing Number
<b>UW-10</b>
Date: 06/10/2015
Drawn      Checked
DD          VR

