


DRIP VALVE: VALVE MAY BE OF ANY TYPE. IF DRIP VALVE HAS HOSE THREADS A NON-REMOVABLE VACUUM BREAKER MUST BE INSTALLED.

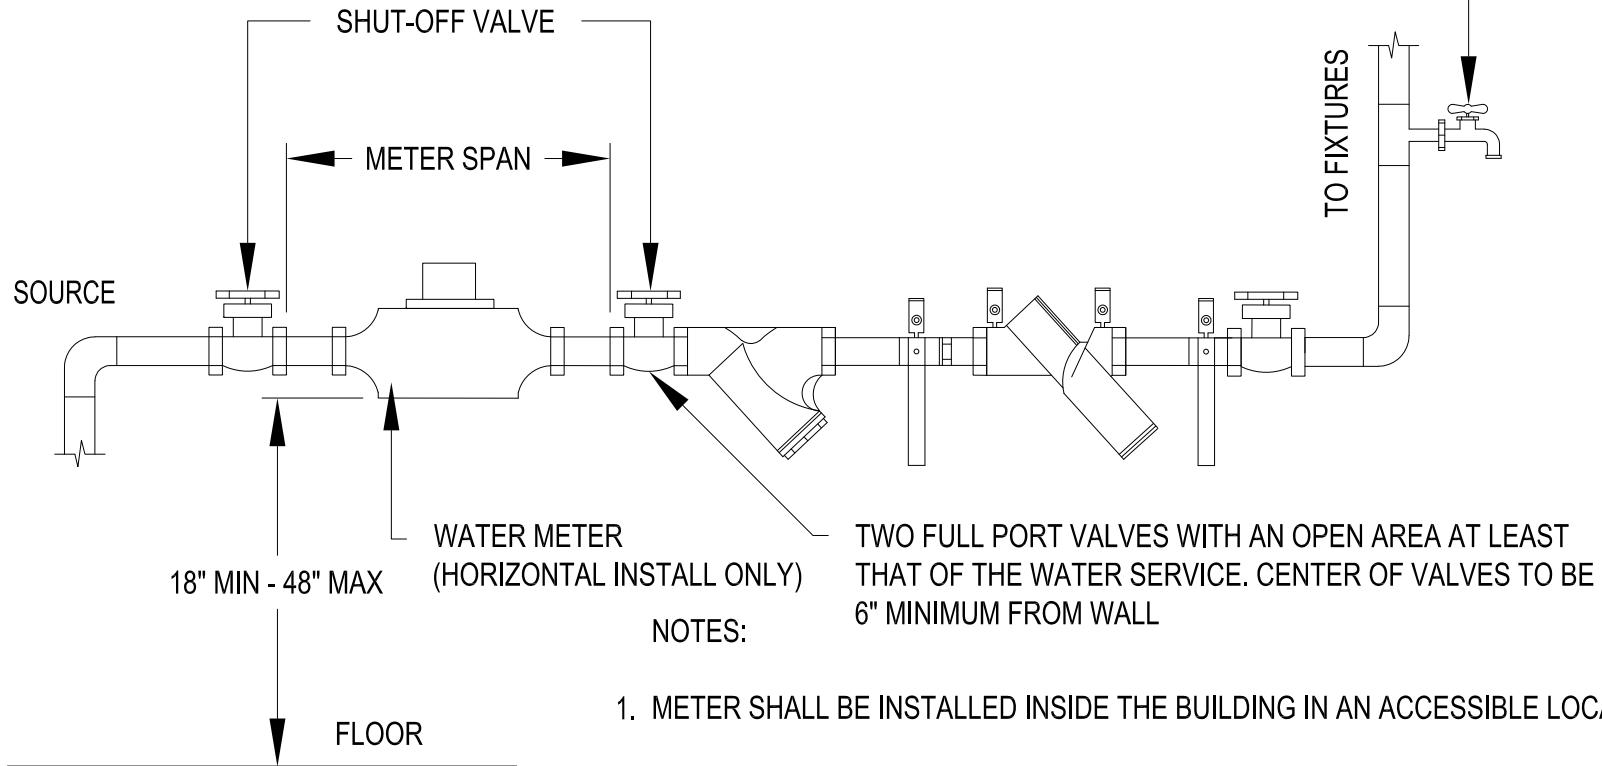

NOTES:

1. METER SHALL BE INSTALLED INSIDE THE BUILDING IN AN ACCESSIBLE LOCATION.
2. METER SHALL NOT BE INSTALLED IN CRAWL SPACE OR PIT.
3. INSTALL BACKFLOW DEVICE PER ILLINOIS STATE PLUMBING CODE REQUIREMENTS.
4. PROVIDE A MINIMUM 12" OF CLEARANCE ABOVE THE METER.
5. METER TO MEET MANUFACTURERS SPECIFICATIONS FOR UPSTREAM PIPE REQUIREMENTS.

Revised:
1. 06/12/2015
2. 08/18/2023
3.
4.

Drawing Name
WATER METER INSTALLATION WITH BACKFLOW DEVICE

Drawing Number
UW-11
Date: 06/10/2015
Drawn Checked
DD VR



City of
Crystal Lake
Illinois